Rate of Maintenance Fluids in MAU

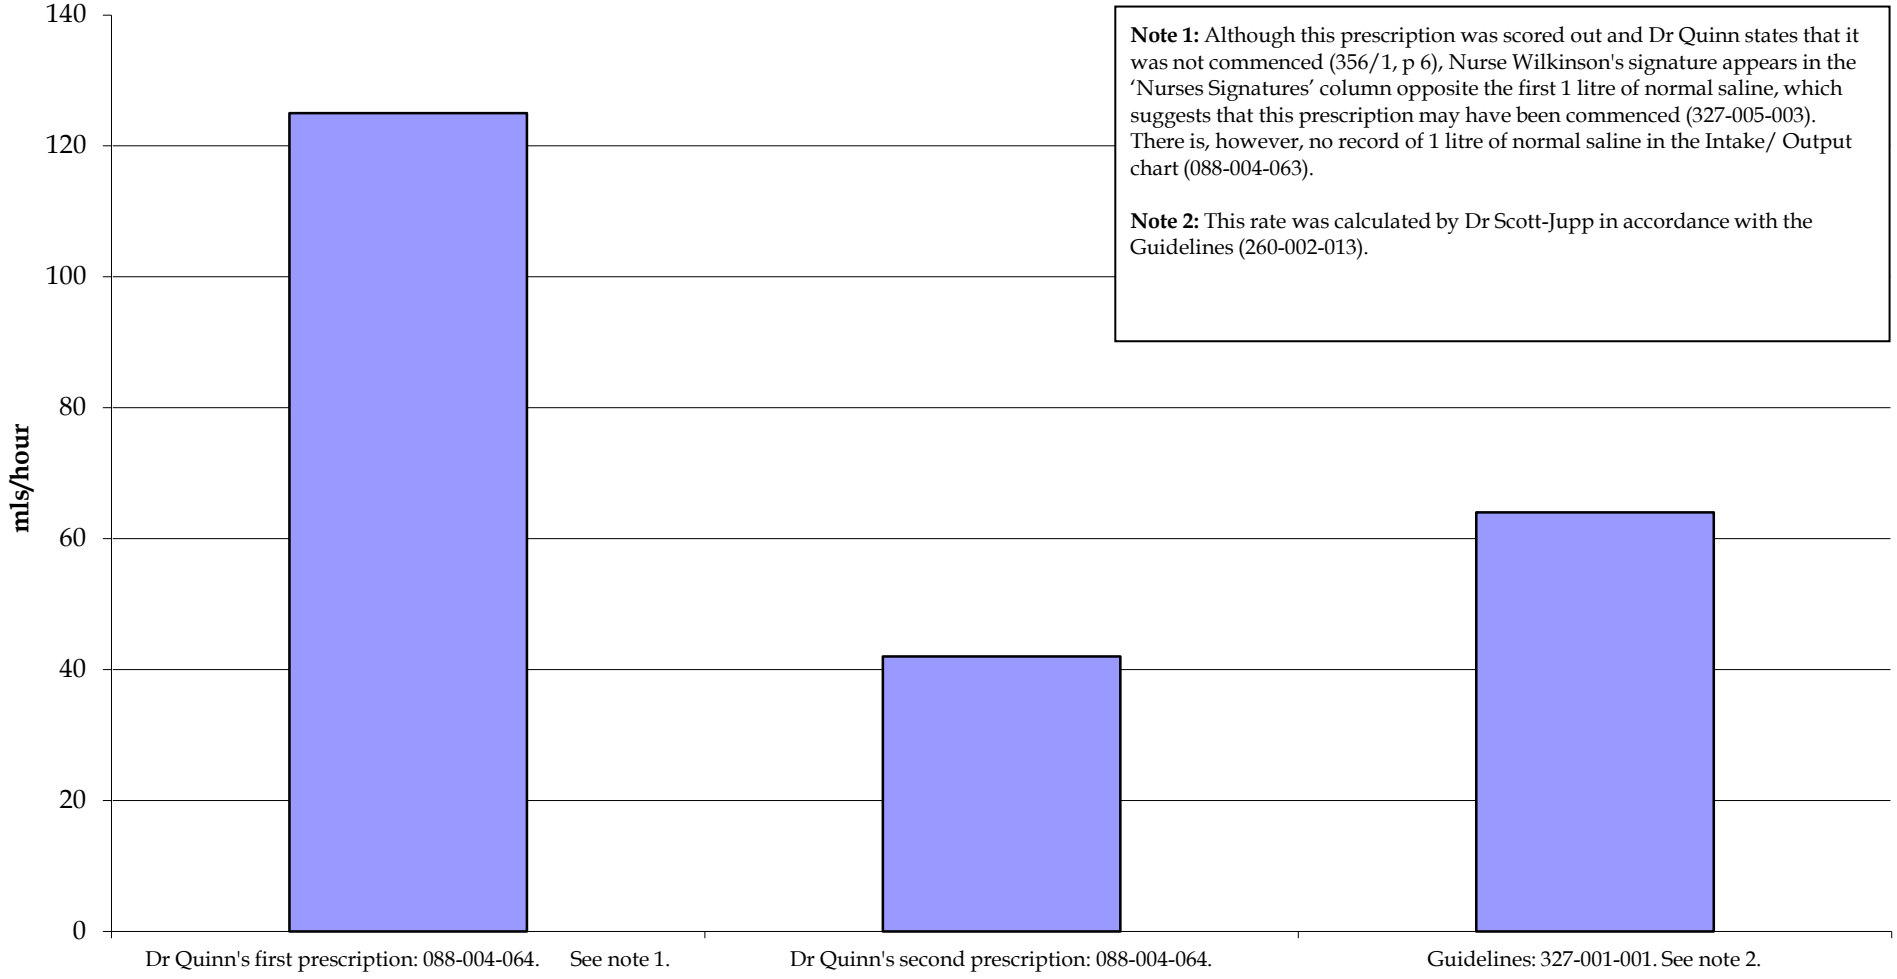

Note 1: Although this prescription was scored out and Dr Quinn states that it was not commenced (356/1, p 6), Nurse Wilkinson's signature appears in the 'Nurses Signatures' column opposite the first 1 litre of normal saline, which suggests that this prescription may have been commenced (327-005-003). There is, however, no record of 1 litre of normal saline in the Intake/ Output chart (088-004-063).

Note 2: This rate was calculated by Dr Scott-Jupp in accordance with the Guidelines (260-002-013).